




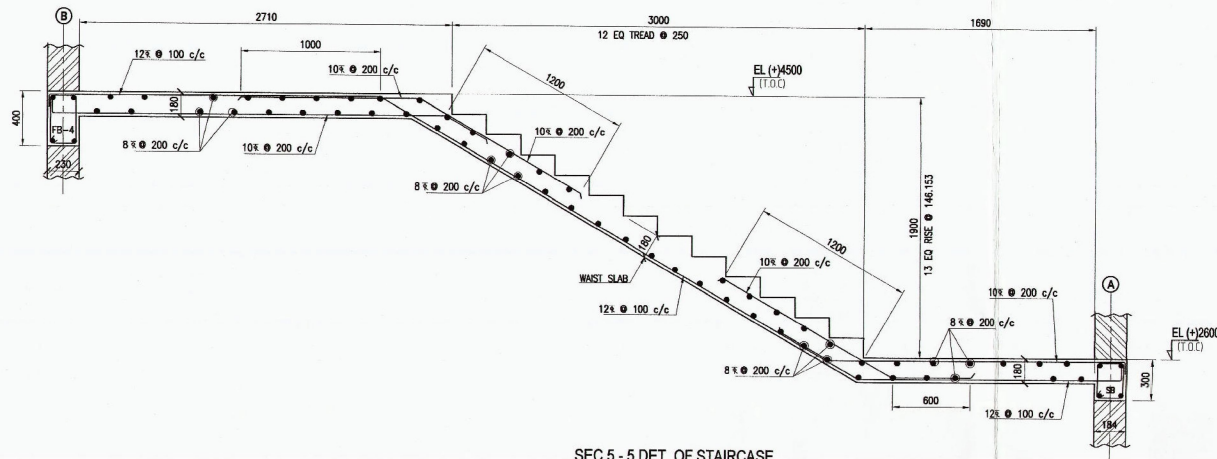


SEC 5 - 5 DET. OF STAIRCASE

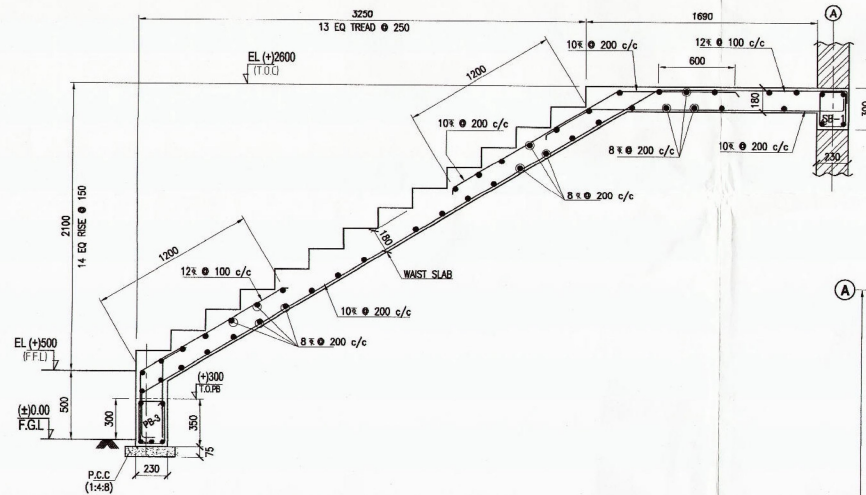

SEC 4 - 4 DET. OF STAIRCASE

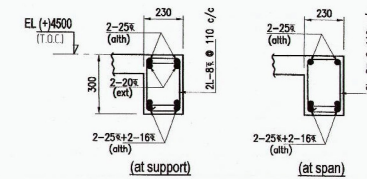

DET. OF SB-1(230x300)

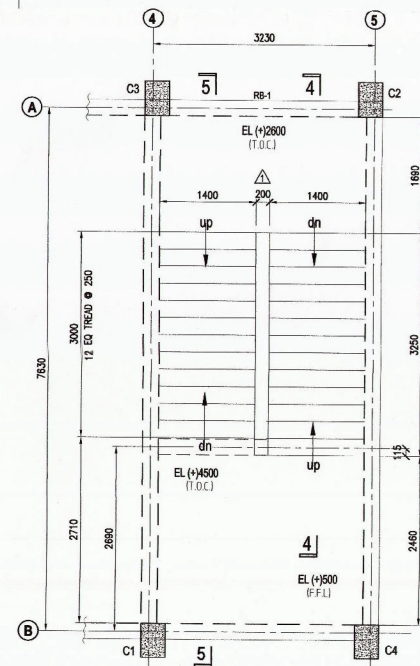

DET. LAYOUT PLAN OF STAIRCASE

Drawing is approved
subject to overall
responsibility of the contractor
in terms of contract agreement
or, turn key for the work

Chief Engineer (Civil)
BSPTCL

Assistant Engineer (Civil)
BSPTCL

Executive Engineer (Civil)
BSPTCL

Superintending Engineer (Civil)
BSPTCL

- NOTES:-
1. ALL DIMENSIONS ARE IN mm & LEVELS ARE IN M, UNLESS NOTED OTHERWISE.
 2. E.L. (+)0.00 CORRESPONDENCE TO F.G.L.
 3. GRADE OF R.C.C. - M-20
 4. CLEAR COVER TO MAIN RE-INFORCEMENTS:-
a) FLOOR & ROOF BEAM - 25mm, d) SLAB - 20mm.
 5. # DENOTES HIGH YIELD STRENGTH DEFORMED TMT BARS OF CHARACTERISTICS STRENGTH $F_y = 500 \text{ N/mm}^2$.
 6. MINIMUM ANCHORAGE LENGTH OF BARS SHALL BE $50 \times \text{DIA OF BARS}$.
 7. BARS TO BE LOCALLY ADJUSTED TO AVOID CUT OUTS, POCKETS, INSERTS ETC.
 8. LAP LENGTH = $50 \times \text{DIA OF BARS}$ IN STAGGERED POSITIONS.
 9. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH TECHNICAL SPECIFICATIONS.
 10. 251390 shall be applicable for details of reinforcement.

Bihar State Power
Transmission Company
Limited (BSPTCL)

Title: FFPH BUILDING - DETAILS OF STAIRCASE

Drg.No.: - CD_FFPHBLDG_06-03

Scale:
1:100

Sheet:
03 OF 03