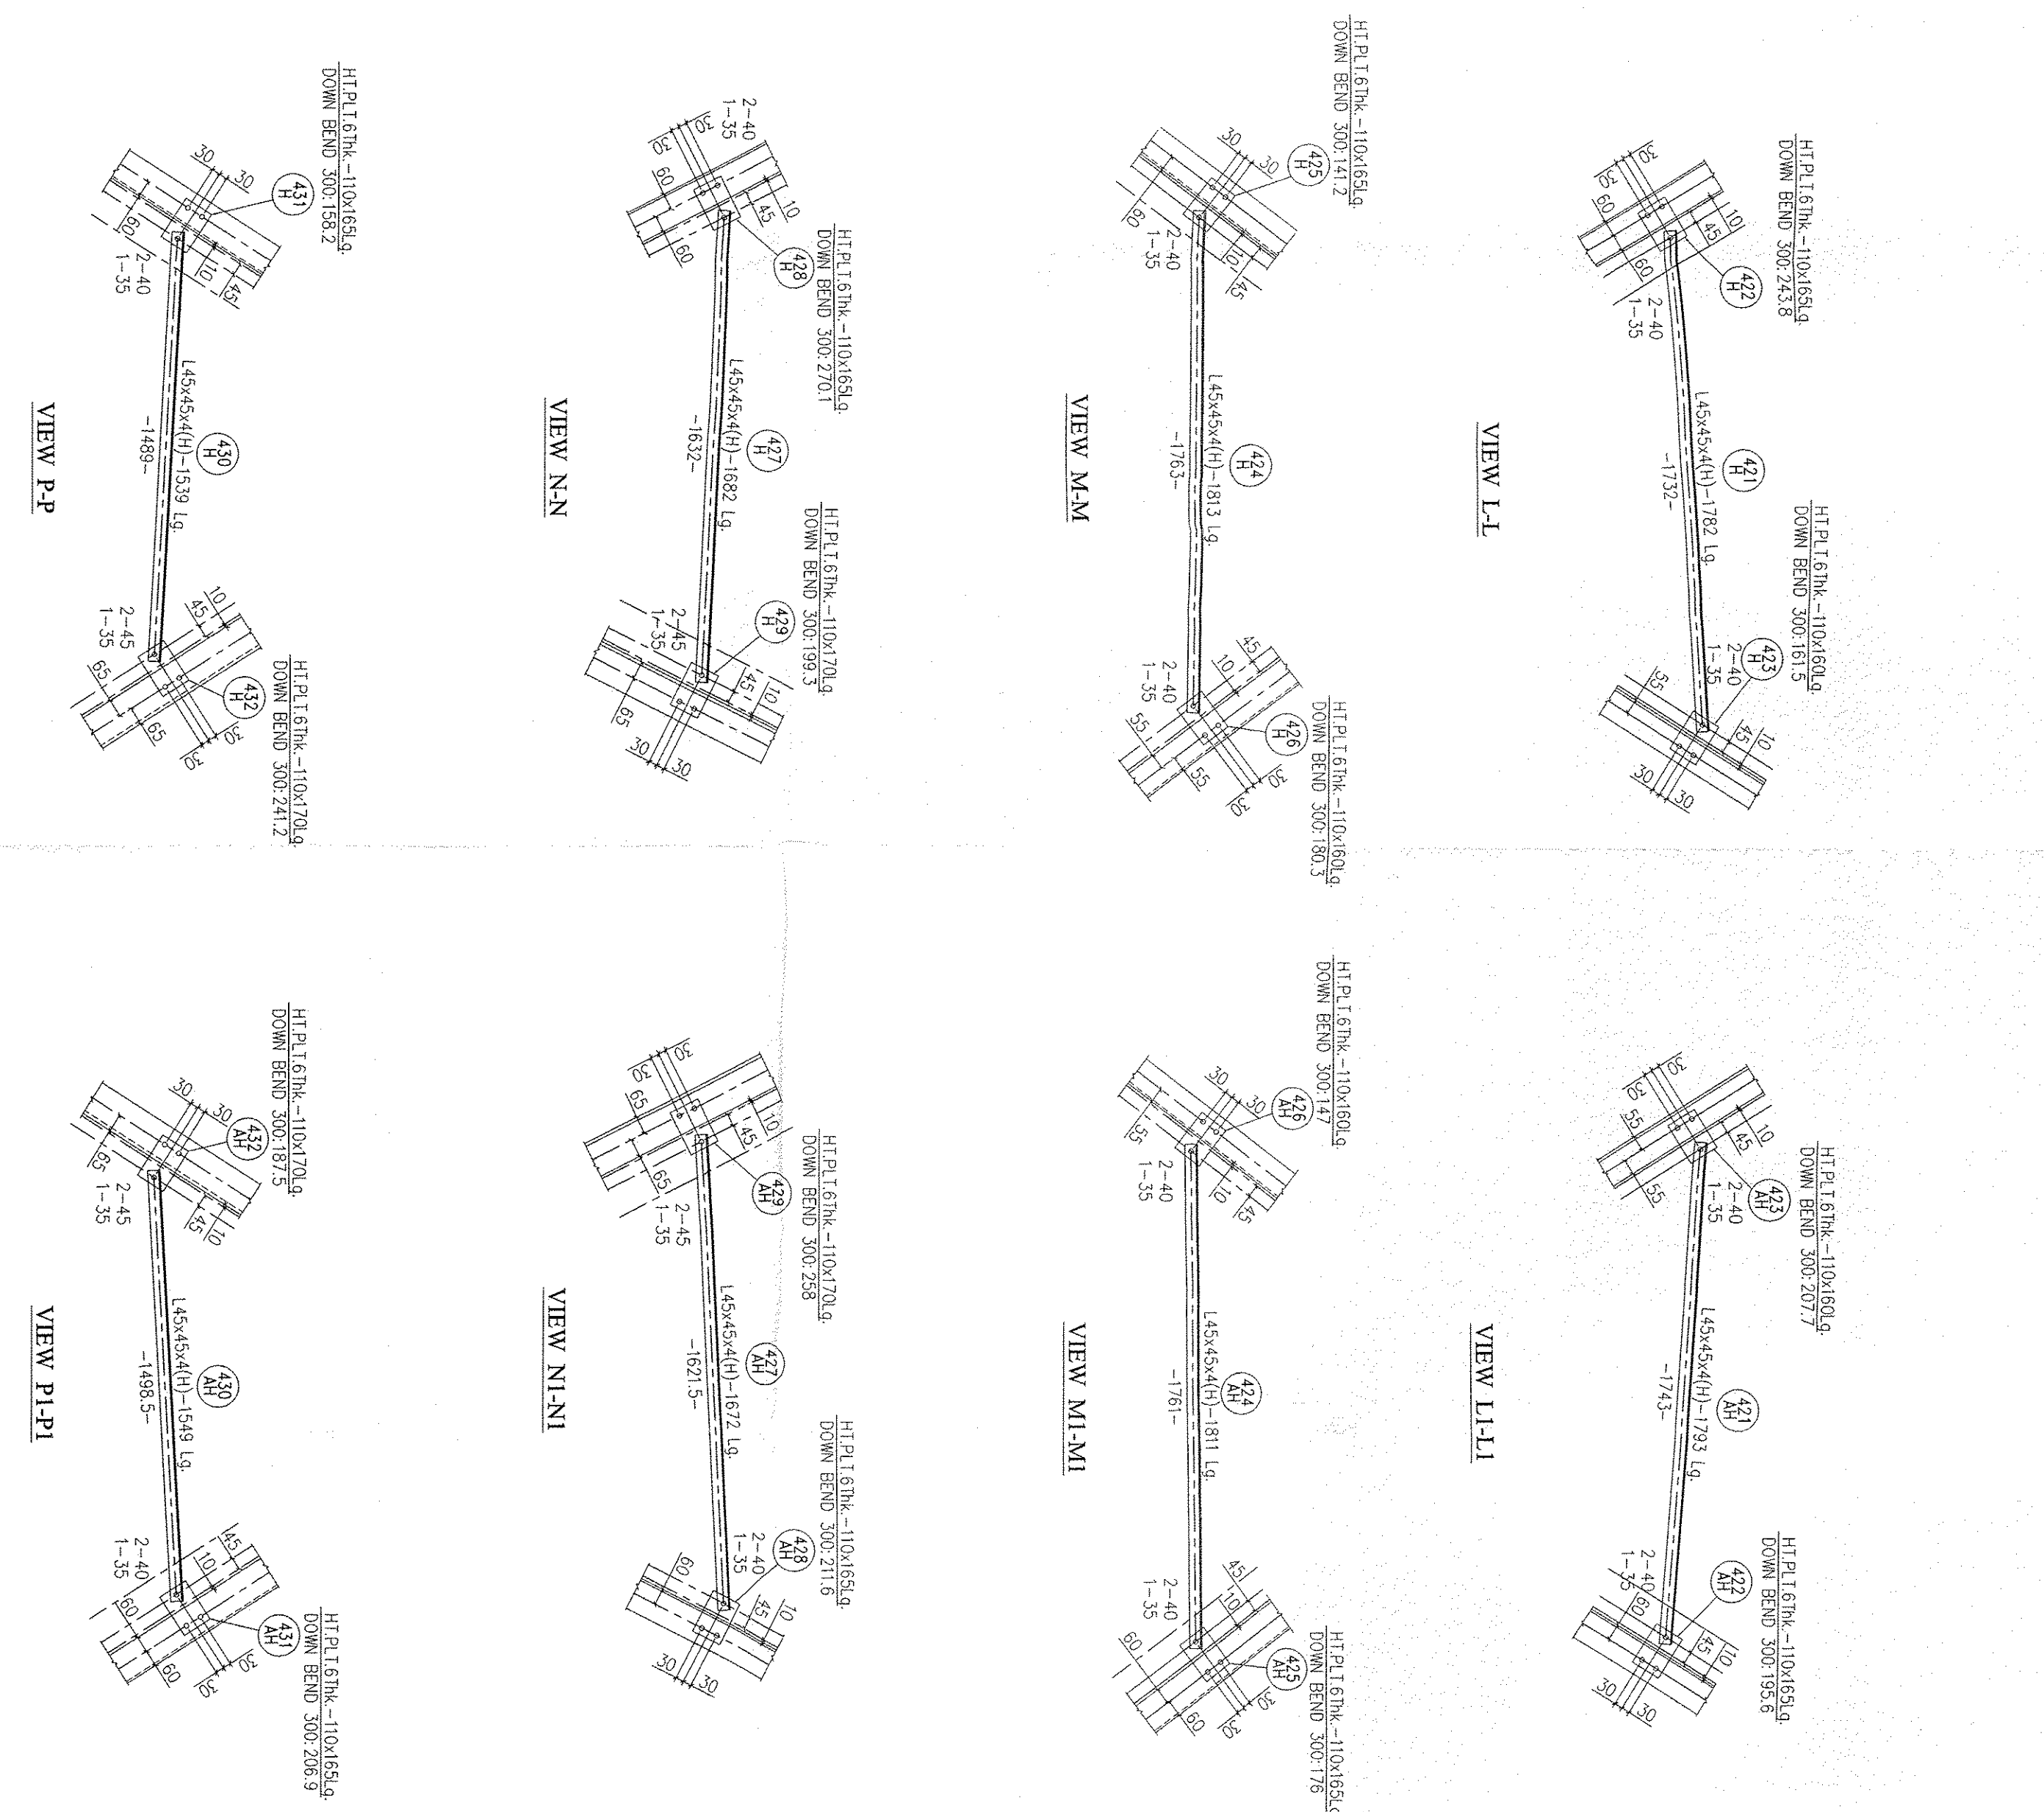
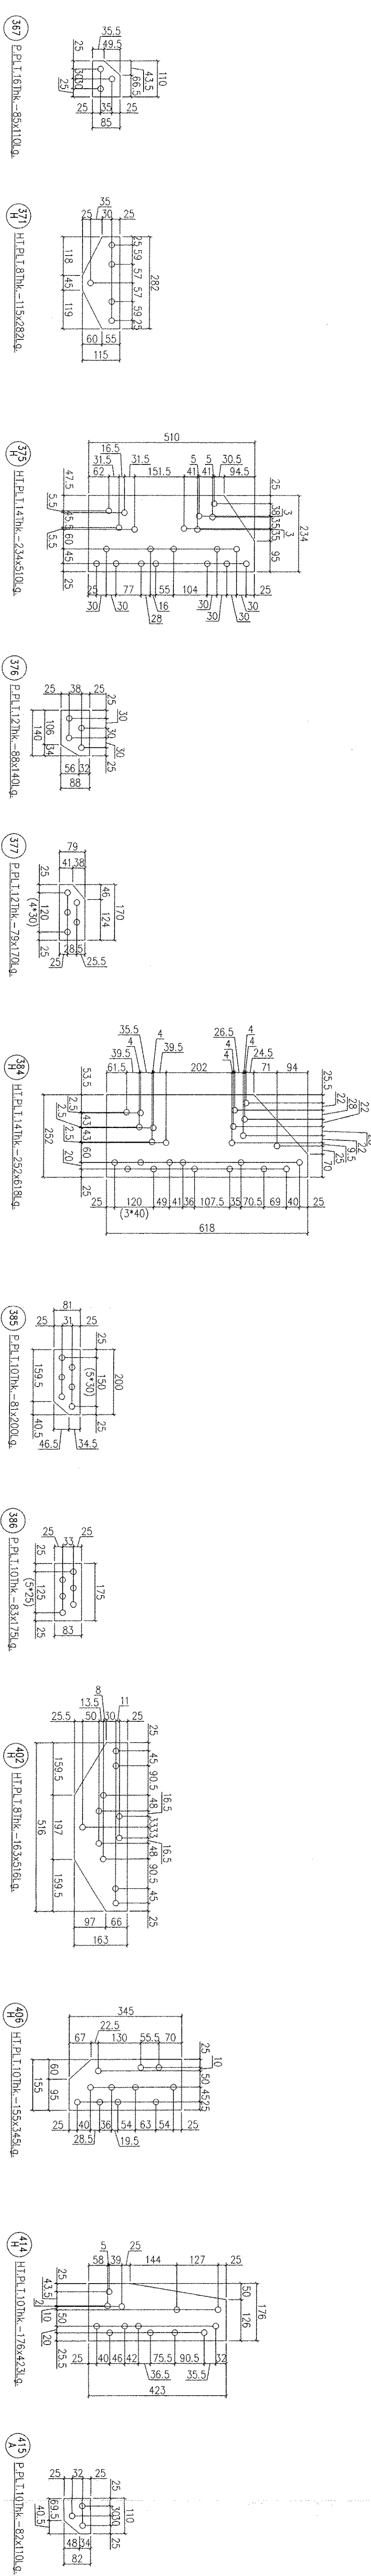
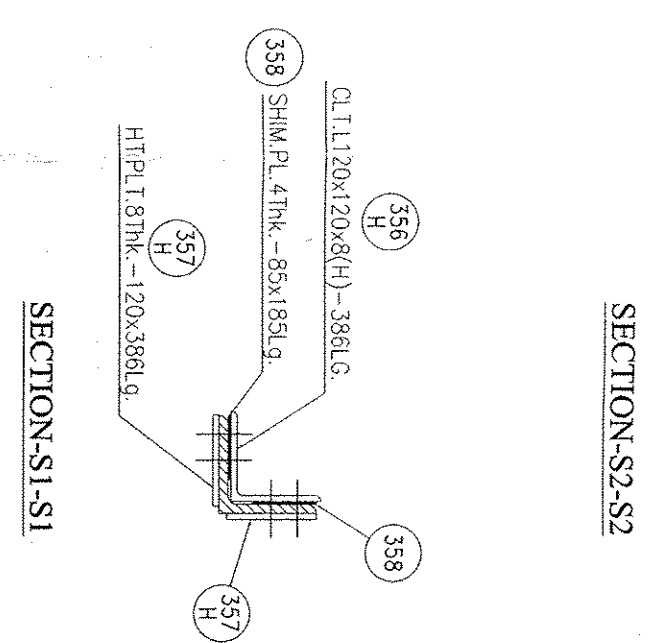
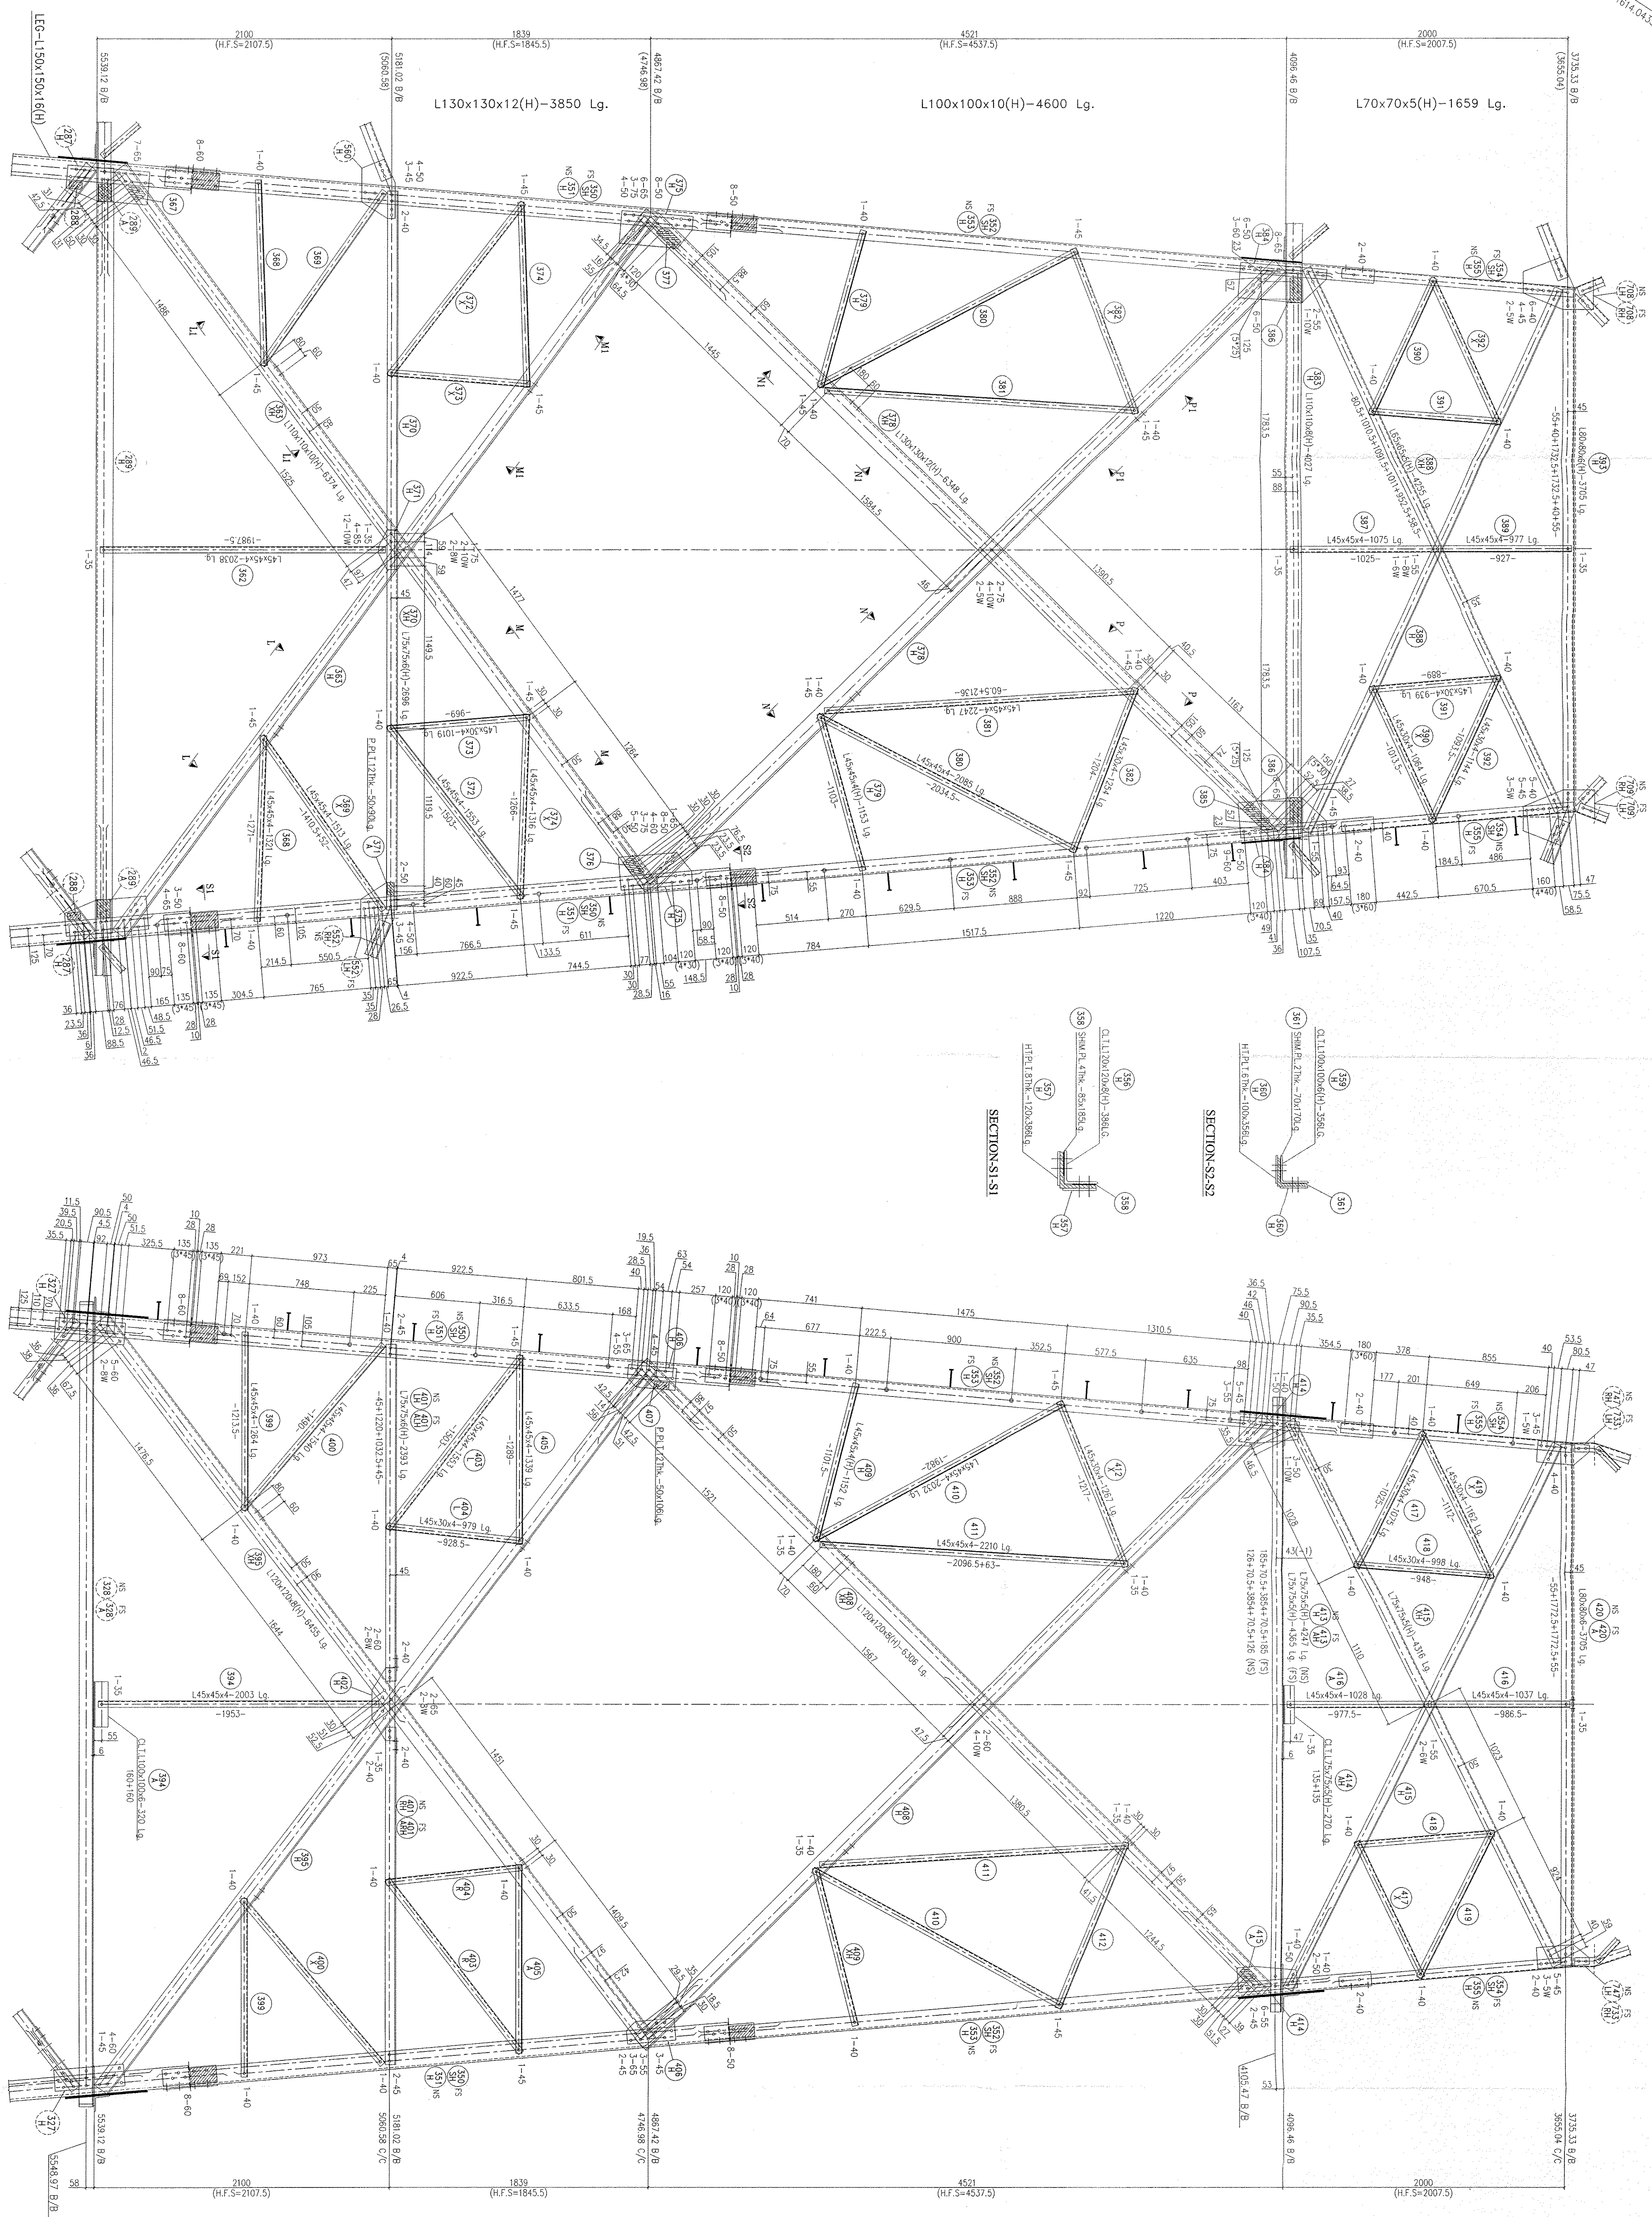
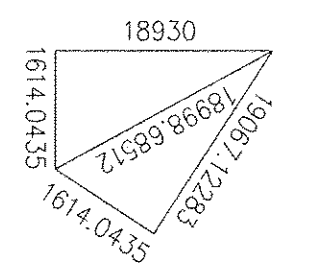


[illegible]

SUCCESSFULLY TESTED AT
L&T-TLTRS-KANCHIPURAM
ON 23rd OF JULY 2019

**SUCCESSFULLY TESTED AT
L&L-TITRS-KACHIPHAM
ON 23rd OF JULY 2019**

REVISIONS		APPROVAL	DATE	REVISION
2.07.19	1	DISCUSS AFTER SUCCESSFUL TESTING		
1.01.19	0	FIRST SUBMISSION FOR APPROVAL, BIDDING PHOTO		

BIHAR STATE POWER TRANSMISSION CO.LTD., PATNA
APPROVED

L&T Construction
Power Transmission & Distribution

Supplied as per specification

Electrical Superintendent Engineer

88.06 Planning and Procurement

PHASE "B" UNDER STAIR PLANS (see 202). CONSTRUCTION OF STAIRS SHALL BE AS FOLLOWS:

- (I) LLO OF BAKHTYARHATTA 400 KC (QUAD) AT BAKHTYARPUR (LINE LENGTH 108 KM),
- (II) 220 KV D/C BAKHTYARPUR - SHEKHPURA (LINE LENGTH - 51 KKM)
- (III) 220 KV D/C BAKHTYARHATTA (LINE LENGTH - 52 KKM) AND
- (IV) 220 KV D/C BAKHTYARHATTA (LINE LENGTH - 52 KKM) AND

JOB No. : 01868-1-1L	TITLE :	SCALE :
NAME :		
DATE :		
DSGN :		
RSK :	25.02.19	
G.A. OF CAGE PART-2 FOR		1 : 20
TOWN OF WOODEN COALFIELD		

DRG. No.	018080-T-8D-GA-0A0A	400KV D/C QUAD ACSR MOOSE (WZ-4)	3 OF 3
APPD	CSR	26.02.19	SHEET
		26.02.19	

RELEASED FOR	☐ PRELIMINARY	☐ TENDER	☐ INFORMATION	☒ APPROVAL	☐ CONSTRUCT
3	2			1	

This document is the property of BSPTCL and must not be passed on to any third person or firm not authorised by BSPTCL, nor be copied/made use of in full or part by such person or firm without our prior permission in writing.