
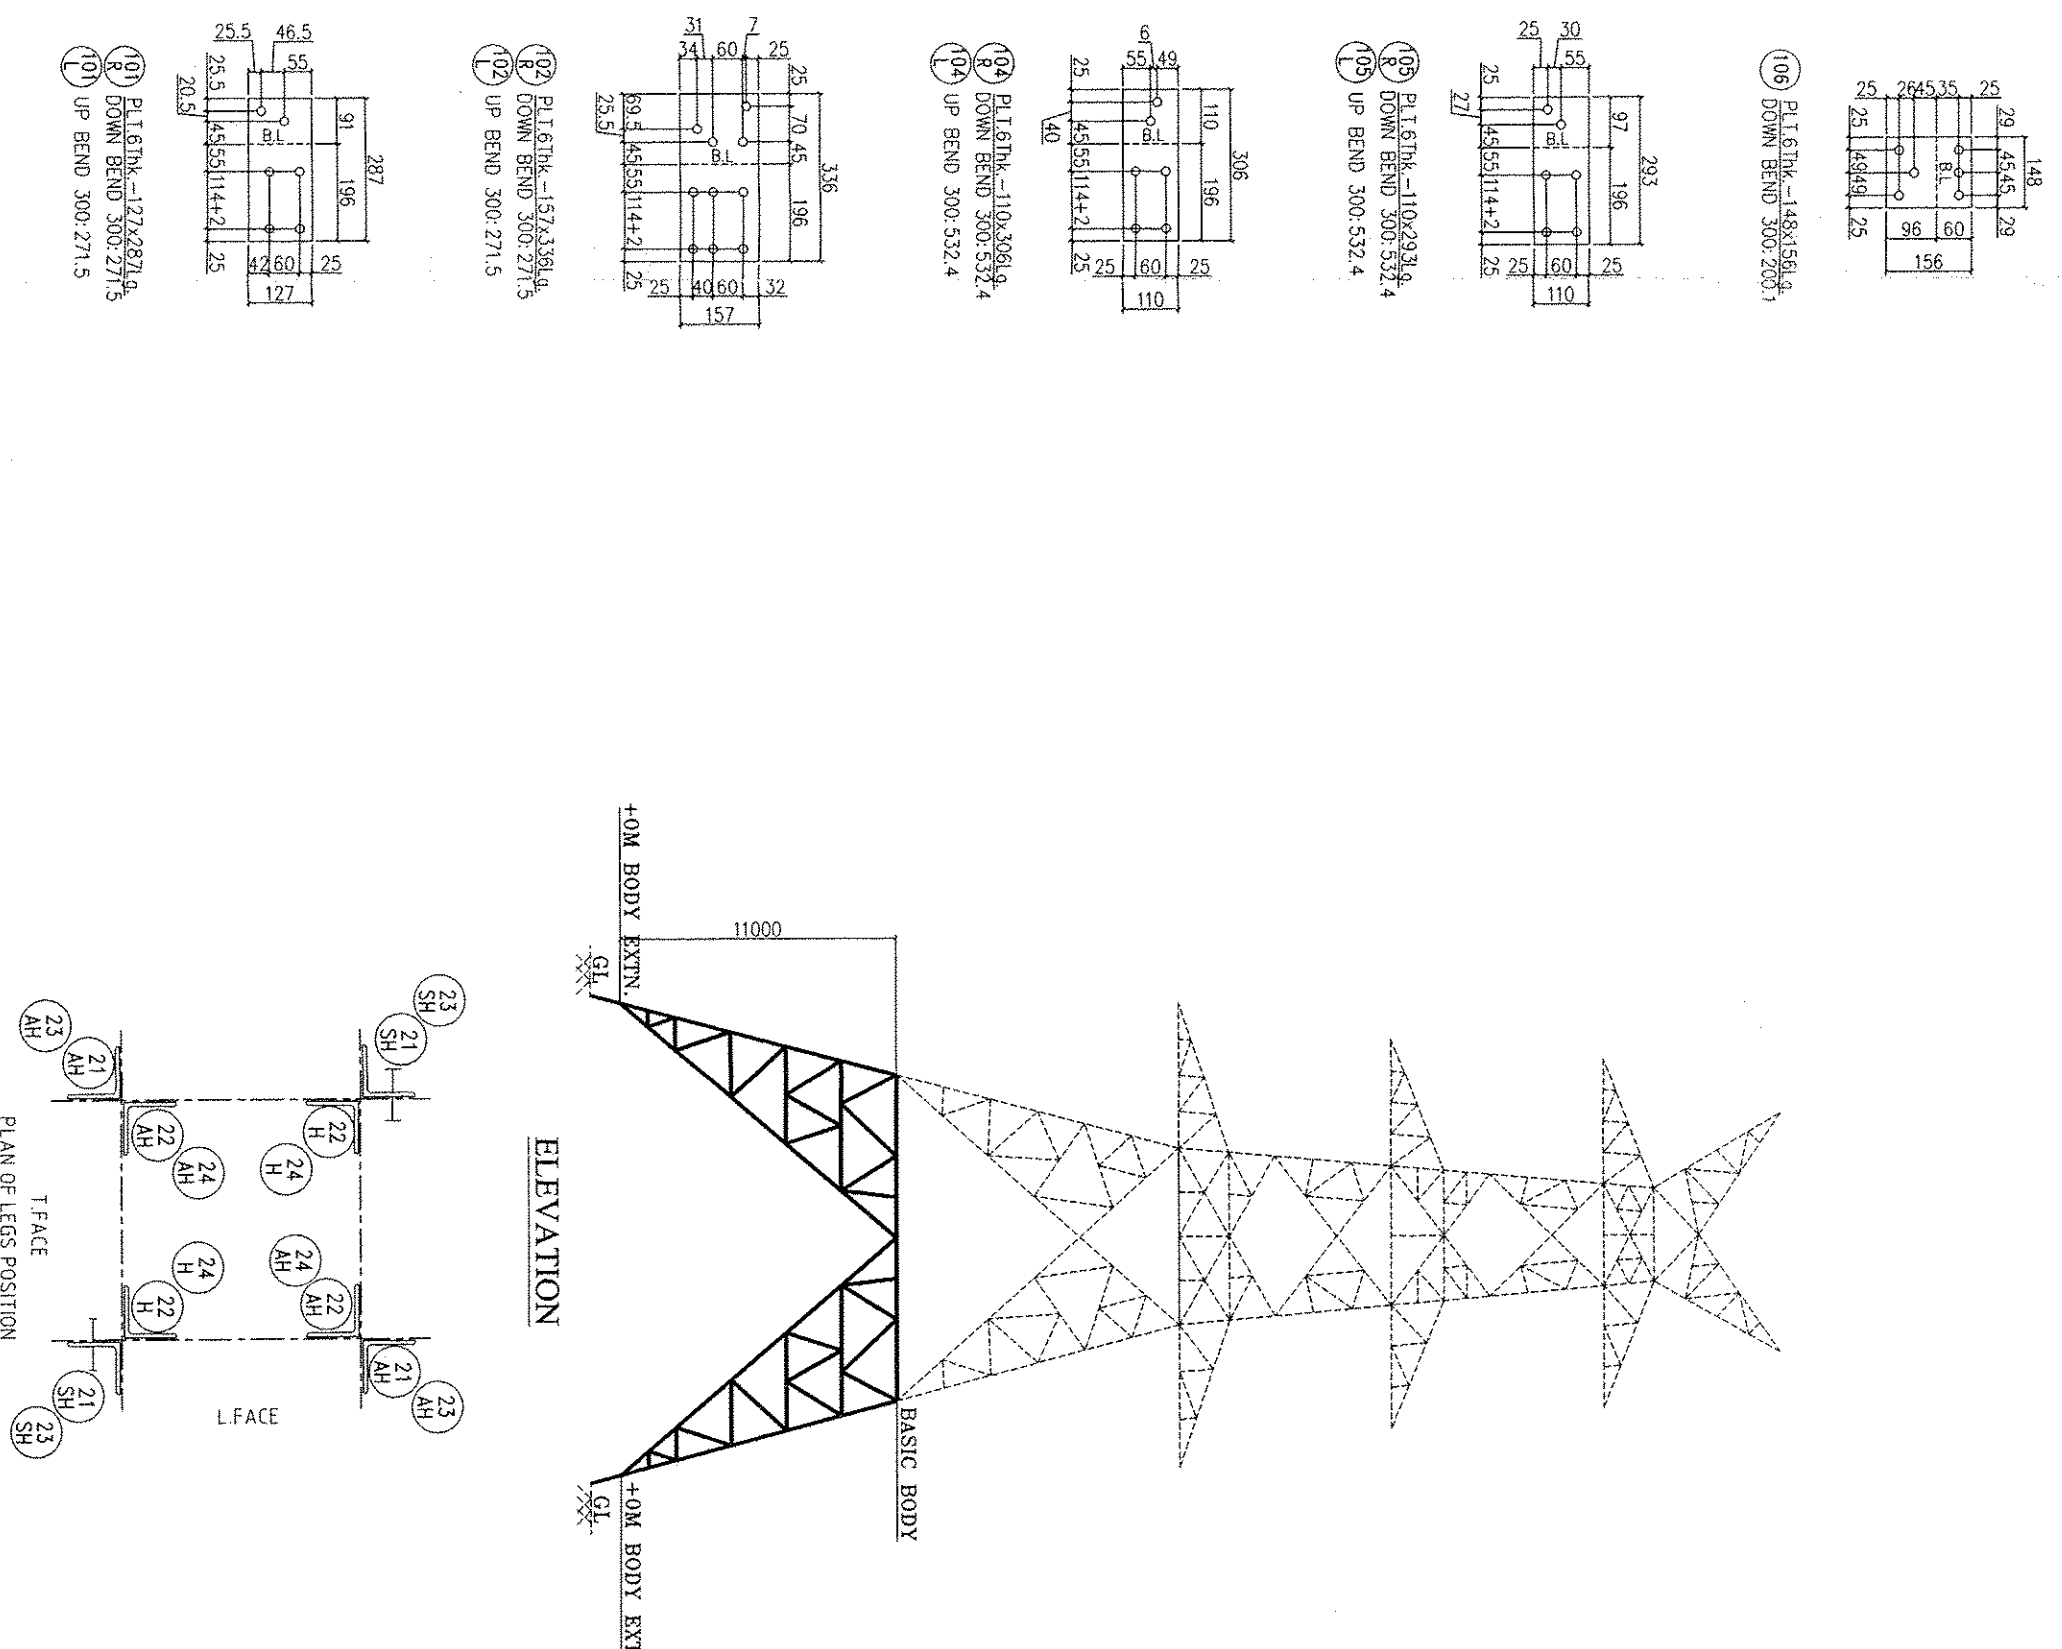
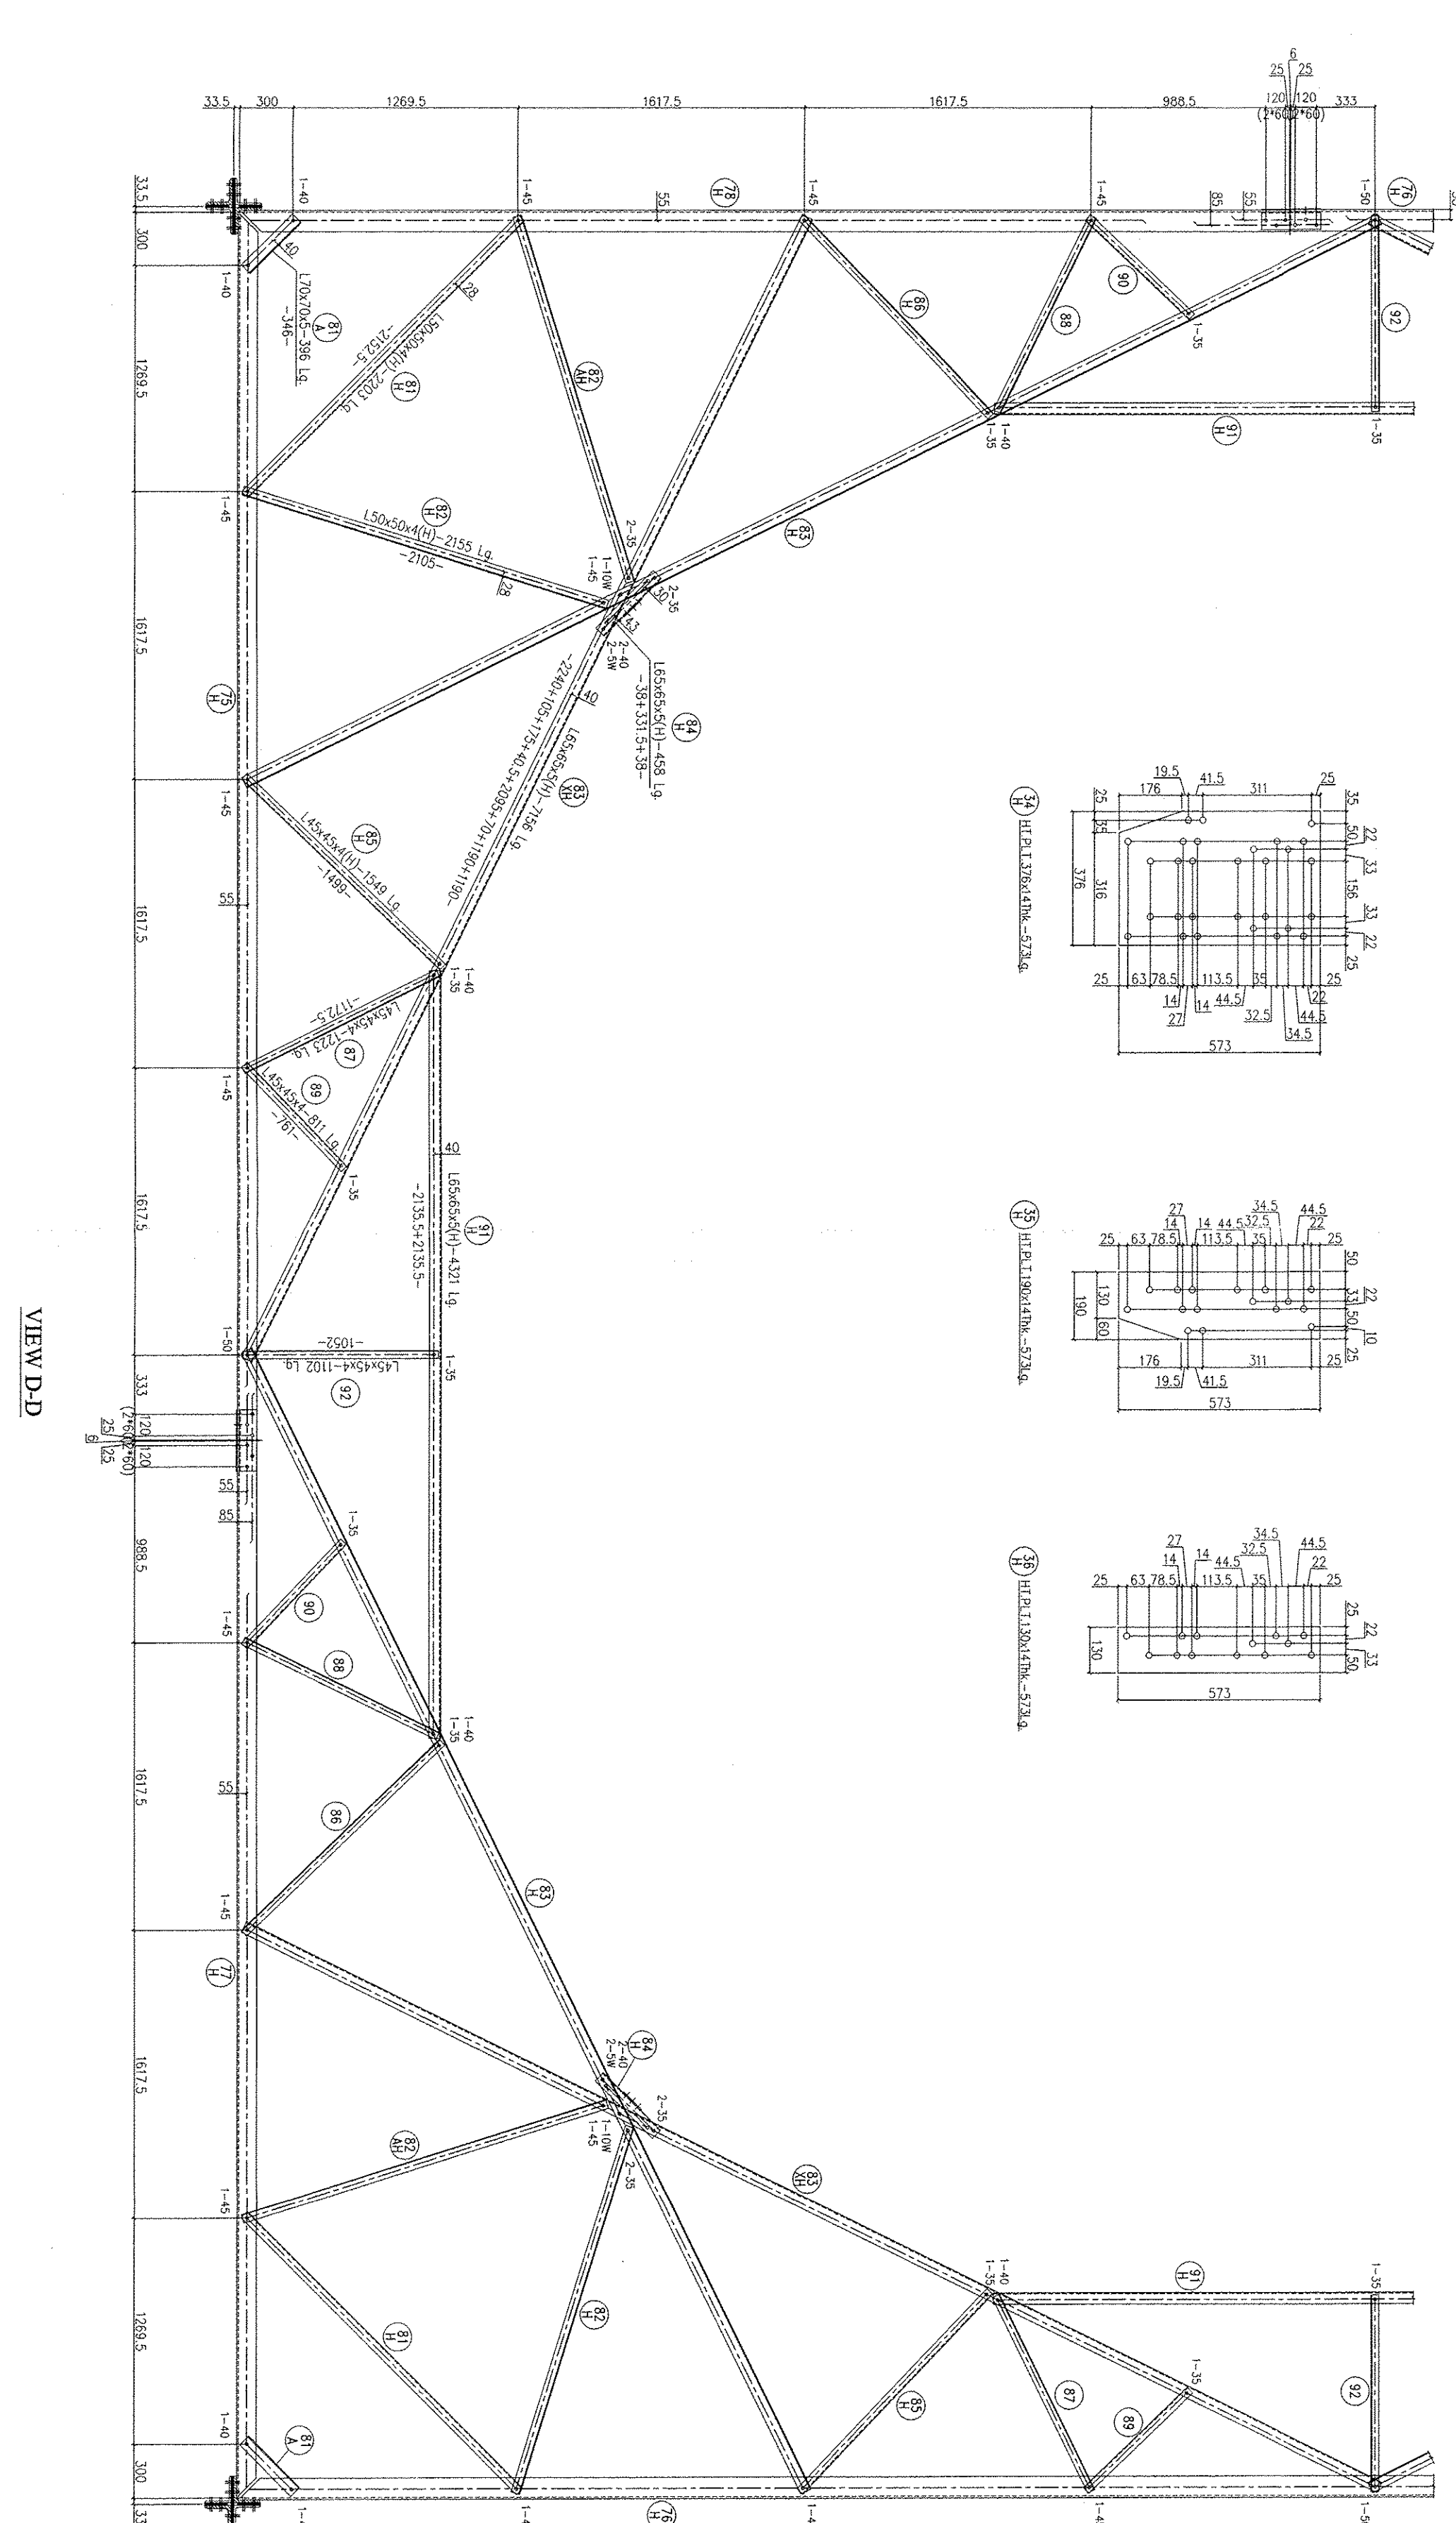


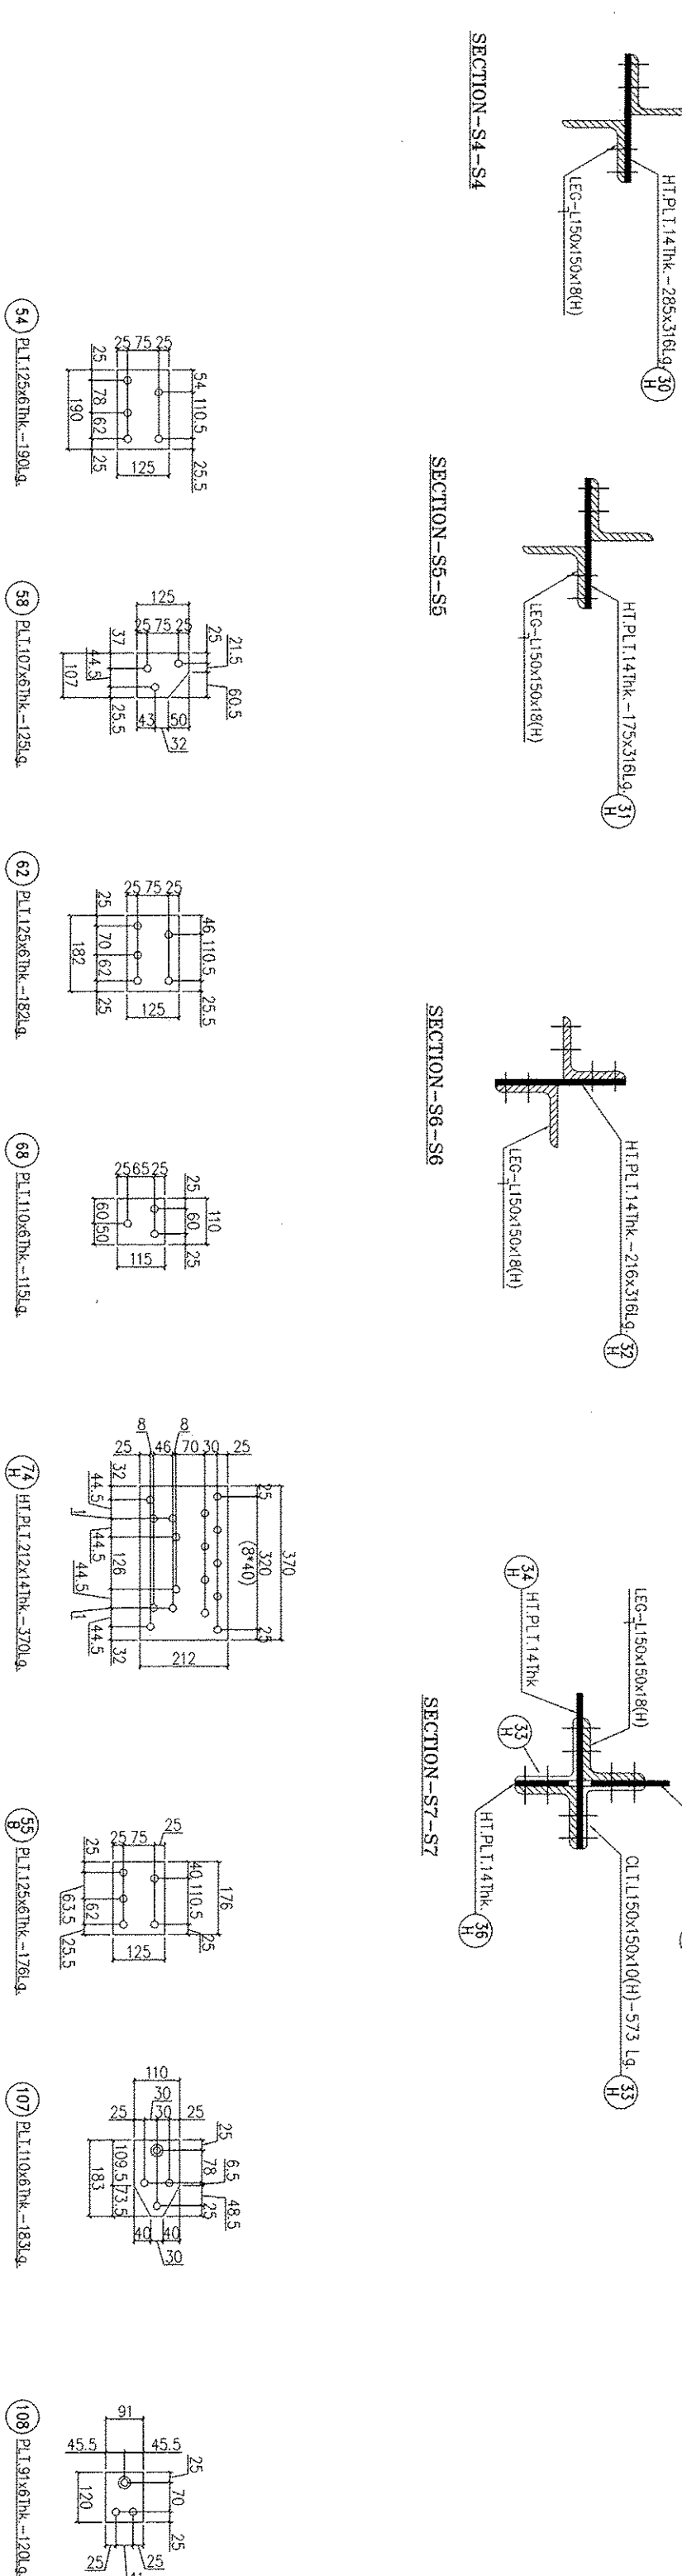

COMPARISON OF DRY, MILK & WATERS			
SIZE	DRY	GRAZE	RELATIONS
160 x 12mm 1/2	304	55	D.R.T. & M.T.
160 x 12mm 1/2	250	55	D.R.T. & M.T.
160 x 12mm 1/2	224	55	D.R.T. & M.T.
160 x 12mm 1/2	224	55	D.R.T. & M.T.
160 x 12mm 1/2	418	55	D.R.T. & M.T.
160 x 12mm 1/2	320	55	D.R.T. & M.T.
160 x 12mm 1/2	320	55	D.R.T. & M.T.
160 x 12mm 1/2	32	55	D.R.T. & M.T.
160 x 12mm 1/2	32	55	D.R.T. & M.T.
160 x 12mm 1/2	418	55	D.R.T. & M.T.
160 x 12mm 1/2	6	55	D.R.T. & M.T.
160 x 12mm 1/2	6	55	D.R.T. & M.T.
160 x 12mm 1/2	224		GRAZE
160 x 12mm 1/2	44		310 D.R.T.
160 x 12mm 1/2			PACK MASTERS
160 x 12mm 1/2	33		PACK MASTERS
160 x 12mm 1/2	42		PACK MASTERS
160 x 12mm 1/2	42		PACK MASTERS

SUCCESSFULLY TESTED AT
L&T-TLTRS-KANCHIPURAM
ON 23rd OF JULY 2019

1. ALL DIMENSIONS ARE IN MM UNLESS OTHERWISE SPECIFIED.

2. BOLT SYMBOLS: 16 ± 12.54 BOLTS
 16 ± 12.54 HOLES

3. ALL REACTION WALLS ARE TO BE PROVIDED WITH "THROAT"

4. STRUCTURAL STEEL SHALL BE AS PER S-2002-2011

(i) WELD STEEL - GRADE E250 QUALITY A - UNLESS OTHERWISE SPECIFIED

(ii) TIE STAINS FOR FIBRE REINFORCED CONCRETE - GRADE E250 QUALITY A

5. BOLTS & NUTS SHALL CONFORM TO IS - 12427-2001 (P-2007) FOR THE DIMENSIONS

6. BOLTS & NUTS SHALL CONFORM TO IS - 12427-2001 (P-2007) FOR THE DIMENSIONS

7. STAINLESS STEEL SHALL BE AS PER IS-2002-2011

8. SPANNA RAILS SHALL BE CONFORMED TO IS 10063-1984 (P-2004)

9. STEEL BOLTS SHALL BE PROVIDED ON THE EXTERIOR SIDE OF THE REINFORCING LUGS.

10. ALL PARRY MEMBERS OF TESTED FIBRE SHOULD BE PLACED WITH PARRY MEMBERS PREPARED WITH TIE IN ACCORDANCE TO THE STANDARD WORK INSTRUCTIONS

PART NO. 21 TO 108

CLIENT:

SUPPLIER / CONTRACTOR: _____

 **L&T Construction**
Power Transmission & Distribution

PAVADUR - 1111 TL, UNDER 31/16 FLOW (60-62), COTTON PRODUCTION (1000/HA), 1000/HA, 5000/HA
(I) LULO OF BAKHTIYARPURA 400 KV DIC TL (ACSR) TL AT BAKHTIYARPUR (LINE LENGTH - 100 KM),
(II) 220 KV DIC BAKHTIYARPUR - SHEKHUPURA TL (ACSR ZEBRA) (LINE LENGTH - 51 KKM)
(III) 220 KV DIC BAKHTIYARPUR - HATHIDAH TL (ACSR ZEBRA) (LINE LENGTH - 52 KKM) AND
(IV) 220 KV DIC BAKHTIYARPUR - PATHUDA TL (ACSR ZEBRA) (LINE LENGTH - 28 KKM)

JOE No. : 018083-T-IL	TITLE :	SCAL
NAME	DATE	

OSGN		
R9X	25.02.19	
TOWER TYPE "ADN/TO" - 60M / OE/O" - 18.5"		

DATE	26.02.19
BY	SR/BSR
CHKD	

400KV D/C QUAD ACSR MOOSE (WZ-4)

SHEET

[illegible]

URKs. no.	0	1	8	0	8	9	.	T	.	T	L	.	8	D	.	G	A	.	0	4	0	3
	A0																					

RELEASED FOR	☐ PRELIMINARY	☐ TENDER	☐ INFORMATION	☒ APPROVAL	☐ CONSTRUCTION
--------------	--------------------------------------	---------------------------------	--------------------------------------	--	---------------------------------------

[illegible]

bioRxiv preprint doi: <https://doi.org/10.1101/2020.05.14.243400>; this version posted May 14, 2020. The copyright holder for this preprint (which was not certified by peer review) is the author/funder, who has granted bioRxiv a license to display the preprint in perpetuity. It is made available under aCC-BY-NC-ND 4.0 International license.